

(ITB NO. 5632)
RE-ROOFING OF
SOUTH SIDE ELEMENTARY SCHOOL
1011 SOUTHWEST AVENUE
JOHNSON CITY, TENNESSEE

AND

(ITB NO. 5632)
RE-ROOFING OF
WOODLAND ELEMENTARY SCHOOL
2303 INDIAN RIDGE ROAD
JOHNSON CITY, TENNESSEE

BEESON, LUSK & STREET, INC., ARCHITECTS
207 EAST MAIN STREET, SUITE 3C
P.O. BOX 1909 ZIP CODE 37605-1909
JOHNSON CITY, TN 37604-5749
PHONE: 423-928-1175
EMAIL: bls@blsarch.com



SEPTEMBER 21, 2012

ADDENDUM NO. 2

1. Refer to Drawing Sheet SS-1 and specifically to Roof Plan Note 4. Reference to tapered EPS shall be omitted and replaced with Tapered ISO.
2. South Side Elementary School: Minimum thickness of existing insulation, at roof drains, is 4".
3. Woodland Elementary School: Minimum thickness of existing insulation at roof drains is 1-1/2".
4. Refer to Detail AD2 of 1, in regard to junction of parapet wall and brick wall, which is attached and a part of this Addendum No. 2.


END OF ADDENDUM NO. 2

BY TSL DATE 8/29/12 SUBJECT REROOFING OF SHEET NO. AD2 OF 1
 CHKD. BY AKS DATE 8/29/12 **WOODLAND ELEMENTARY SCHOOL** JOB NO. 4289
 JOHNSON CITY, TENNESSEE




WOODLAND ELEMENTARY SCHOOL

NOTE
 THIS DETAIL IS TYPICAL AT ALL JUNCTIONS OF PARAPET WALLS AND BRICK WALLS - TYPICAL ALL LOCATIONS FOR EVERY ROOF FOR ENTIRE SCHOOL

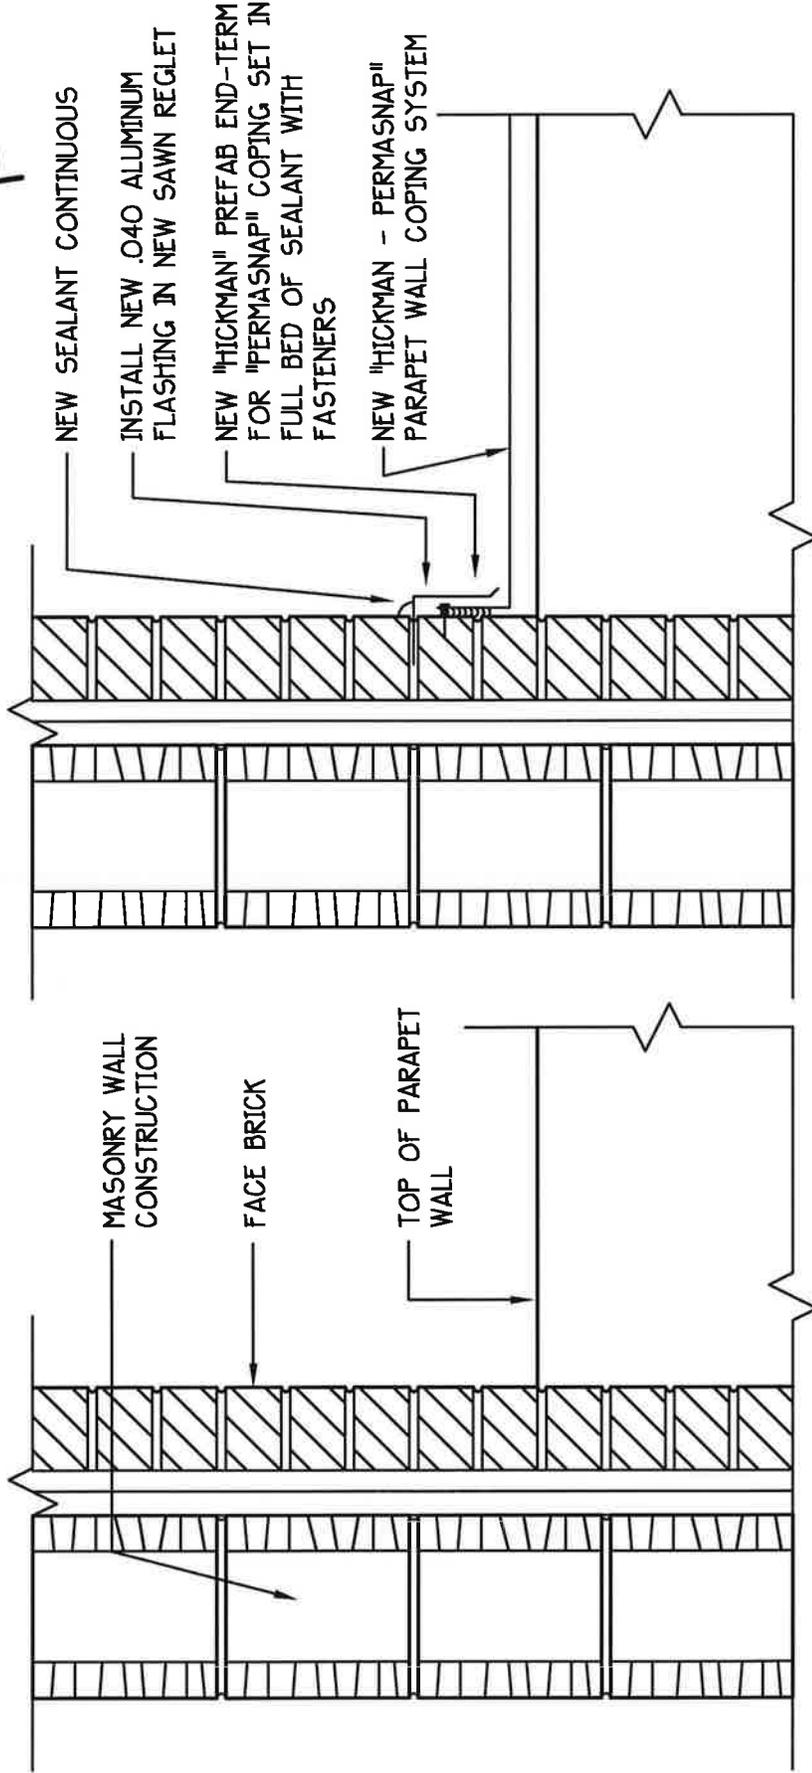

NEW SECTION

SCALE : 1 1/2" = 1'-0"



EXISTING SECTION

SCALE : 1 1/2" = 1'-0"